



Ventilation Technical Guidance

PAS2035:2019+A1:2022 Compliance



1. Overview

This guidance document has been prepared to assist Retrofit Assessors, Designers and Coordinators registered with **ecmk**. The aim of this guide is to provide a clear understanding of the necessity of correctly assessing ventilation requirements and developing an upgrade plan where necessary to comply with PAS2035 when installing any fabric or air tightness energy efficiency measure (EEM).

This guidance has been updated to include revisions to the following documents:

- PAS2035:2019+A1:2022;
- Building Regulations 2010 Ventilation, Approved Document F, Volume 1: Dwellings 2021 revisions (Hereafter referred to as **ADF1** in this document);
- IAA Guidance for Background Ventilation Assessment of Existing Buildings.

One of the most significant changes in Approved Document F, that should be considered is the increased requirement for background ventilation. This is explained in section 4.2 Background Ventilation. The revisions in ADF1 are effective as of 15 June 2022.

This guide is by no means exhaustive, full details of the relevant regulations, industry guidance and compliance requirements can be found in the documents referenced at the end of this guide.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 2
-------------	------------	-------------------------	---------------------------	--------

Table of Contents

1.	Overview.....	2
2.	Why do we need to Assess and Possibly Upgrade the Ventilation System for Retrofit Projects?.....	4
3.	What is a ventilation strategy?	4
4.	What are the Key Ventilation Mechanisms?.....	5
4.1.	Extract Ventilation	5
	Intermittent Extract Ventilation (IEV)	5
	Continuous Extract Ventilation (CMEV or DMEV)	6
	Internal Wall Insulation (IWI) Projects – Extract Ventilation Requirements	6
	Extract Ventilation in Rooms Containing Open Flued Combustion Appliances.....	6
4.2.	Background Ventilation	7
	What is the Total Number of Background Ventilators Required in a Dwelling?	8
	Background Ventilation Requirements for use in Conjunction with Continuous Extract Ventilation	9
	Insulation and Assurance Authority (IAA)	9
	Background Ventilation Assessment of Existing Buildings	9
	Combustion Ventilation Considerations	9
4.3.	Purge Ventilation	10
	Is there a solution to where a habitable room does not have purge ventilation?	10
5.	Installation of ventilation systems	11
6.	Whole Building Ventilation Summary	12
7.	How do we Assess the Existing Ventilation System in a Dwelling?	12
8.	PAS 2035 Annex C 3.5 Ventilation Upgrade Suitable Types	12
9.	Air-tightness – other measures to consider	12
10.	Door undercuts	13
10.1.	Door Undercuts PAS2035 Compliant Evidence Guidelines	13
11.	Positive Input Ventilation (PIV)	13
12.	Ventilation Training and Accreditation	14
13.	Building Regulations Approval – Mechanical Extract Ventilation	14
14.	What Evidence is Required for Compliant Trustmark Lodgment?	14
15.	Ventilation Strategy Template	15
16.	Glossary	16
17.	References	17

2. Why do we need to Assess and Possibly Upgrade the Ventilation System for Retrofit Projects?

The correct installation of any retrofit fabric or air tightness measure e.g. Loft, cavity, external or internal wall, floor insulation, replacement windows or doors and draught proofing, will increase the air tightness of the building envelope. This will reduce the infiltration of fresh air entering the building. This reduction of fresh air must be compensated for. PAS2035 requires that we do this by: -

1. Assess the existing ventilation system.
2. Upgrade where necessary.

If we don't do this, there will probably be an inadequate amount of fresh air entering the dwelling to displace moist or stale air – potentially leading to poor internal air quality, condensation and mould.

Therefore, a ventilation assessment must be carried out whenever the installer designs a retrofit system that includes the addition or upgrade of any fabric or air tightness energy efficiency measures (EEM's).

In addition to complying with PAS2035, there is a legal obligation to comply with the requirements detailed in Building Regulations 2010 Ventilation, Approved Document F, Volume 1: Dwellings 2021 revisions (ADF1).

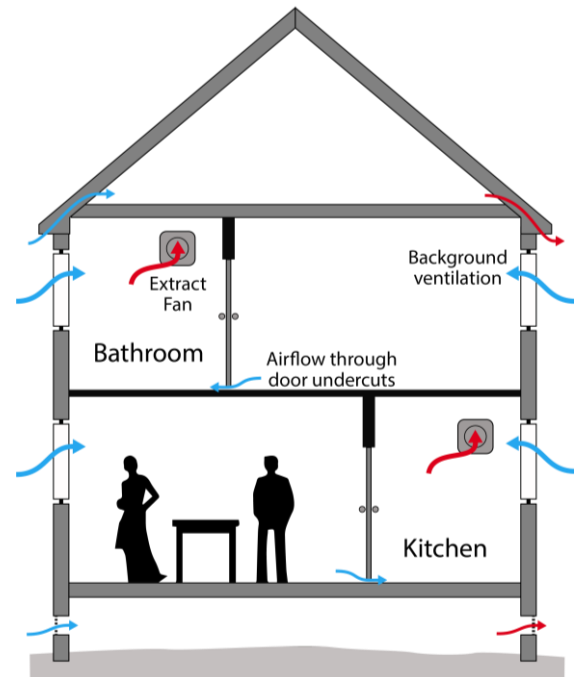


Figure 1

3. What is a ventilation strategy?

A ventilation strategy relies on a combination of the three following key elements: -

Element	Description
Extract Ventilation	From rooms where water vapour or pollutants are likely to be released (e.g. bathrooms and kitchens), to minimise their spread to the rest of the building. Ventilation fans may be either intermittent operation or continuous operation.
Whole Dwelling Ventilation	Provides fresh air to the building and to dilute, disperse and remove water vapour and pollutants not removed by extract ventilation and allows air movement between rooms via door undercuts
Purge Ventilation	Used intermittently for the ventilation of rooms or spaces at a relatively high rate to rapidly dilute and remove pollutants (e.g. fumes from painting) and/or disperse water vapour produced by occasional activities.

The first two elements provide a strategy to ensure a net flow of fresh air into the living spaces, through the dwelling and out through the wet rooms. *(Please see figure 1.)*

The following text provides an overview of the different ventilation mechanisms used, specifications required and guidance to help achieve compliance.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 4
-------------	------------	-------------------------	---------------------------	--------

4. What are the Key Ventilation Mechanisms?

4.1. Extract Ventilation

Extract ventilation to the outside of the dwelling should be provided in all wet rooms to extract moist or stale air from the room to the outside of the dwelling. Wet rooms include the following spaces:

- Kitchens
- Utility rooms
- Bathrooms
- Sanitary Accommodation / WC

There are many different types of mechanical extract fans – the most commonly used for retrofit projects are electrically powered continuous mechanical extract (MEV) or intermittent mechanical extract fans (IEV).

Intermittent Extract Ventilation (IEV)

Table 1.1 below from ADF1, details the minimum extract rates in litres per second (l/s) for intermittent operation extract systems.



PAS2035 states that any intermittent or continuous extract ventilation fans should be checked in accordance with BSRIA guide BG46/2015 to ensure that they are providing adequate air movement, and any incidence of inadequate air movement should be reported as part of the assessment. Whilst **this is not mandatory**, this would always **recommend as best practice**, particularly when assessing the adequacy of an existing higher flow rate fan such as that installed in a kitchen without cooker hood extraction.

Table 1.1 Minimum extract ventilation rates for intermittent extract systems

Room	Intermittent extract rate (l/s)
Kitchen (cooker hood extracting to the outside) ⁽¹⁾	30
Kitchen (no cooker hood or cooker hood does not extract to the outside) ⁽²⁾	60
Utility room	30
Bathroom	15
Sanitary accommodation ⁽³⁾	6

NOTES:

- See Diagram 1.1.
- See Diagram 1.2.
- As an alternative for sanitary accommodation, the purge ventilation guidance may be used.

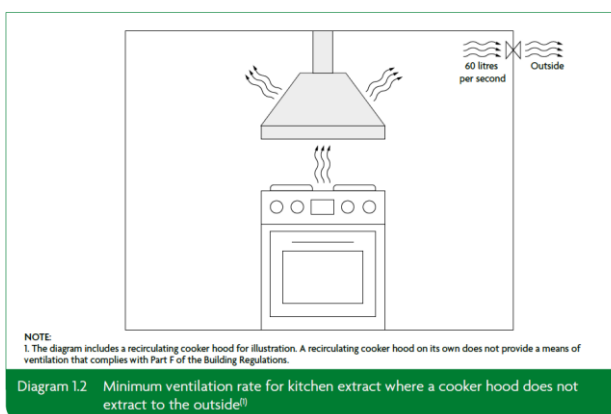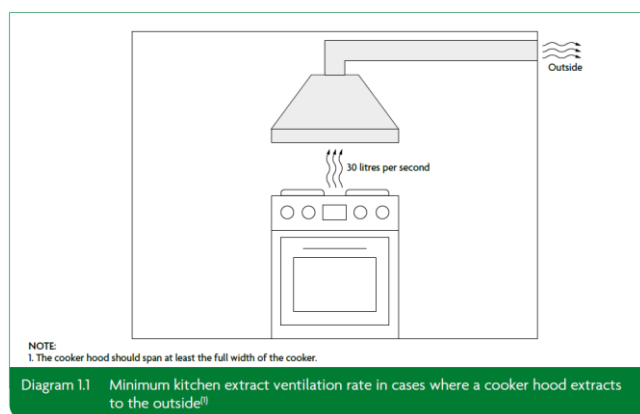

Where an IEV is found to be defective or not capable of delivering adequate performance, in accordance with PAS2035 Annex C 3.5, this must be upgraded with a compliant type of ventilation – generally the most convenient type being continuous extract ventilation. Please see section 8. PAS 2035 Annex C 3.5 Ventilation Upgrade, for further details.

Continuous Extract Ventilation (CMEV or DMEV)

Continuous extract ventilation generally uses less energy than traditional intermittent ventilation and is therefore a much more cost effective and low carbon option – also they are quicker and easier to install. Minimum extract ventilation rates for continuous extract systems are specified in Table 1.2. A continuous rate is given for the general operation of the fan and a high rate for when additional extraction is required.

Table 1.2 Minimum extract ventilation rates for continuous extract systems⁽¹⁾

Room	High rate (l/s)	Continuous rate
Kitchen	13	The sum of all extract ventilation in the dwelling on its continuous rate should be at least the whole dwelling ventilation rate given in Table 1.3
Utility room	8	
Bathroom	8	
Sanitary accommodation	6	
NOTE:		
1. If the continuous rate of ventilation provided in a room is equal to or higher than the minimum high rate specified in the table, no extra ventilation is needed.		

Internal Wall Insulation (IWI) Projects – Extract Ventilation Requirements

Generally, only the installation of insulation on 100% of internal walls is compliant with PAS2035:2019. However, in many cases wet rooms such as kitchens and bathrooms will have permanent fixtures installed which cannot be **easily or practically** removed for the purpose of installing the insulation. In this case, these wet rooms can be omitted as long as: -

- a.) The room can be heated to 18°C when occupied, and
- b.) **Continuous extract ventilation** is installed in the wet rooms in question.

Ref: IAA Guidance: <https://www.theiaa.co.uk/partial-insulation-for-iwi/>

Or <https://www.gov.uk/government/publications/retrofit-internal-wall-insulation-best-practice>

Extract Ventilation in Rooms Containing Open Flued Combustion Appliances

If extract ventilation is required in rooms that contain, or in rooms adjacent to open flued combustion appliances or solid fuel open fires, a post-install safety test must be carried out in accordance with Approved Document J. **This must be carried out to confirm that combustion appliances operate safely regardless of whether the extract fans are running or not.**

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 6
-------------	------------	-------------------------	---------------------------	--------

4.2. Background Ventilation

All rooms with external walls should be equipped with background ventilators.¹

A background ventilator is a small ventilation opening designed to provide controllable whole building ventilation. These must be present in **every habitable** room in the dwelling to allow the entry of fresh air into the room to replace the air being extracted from wet rooms.

The typical types of ventilators used are trickle vents – located at the top of windows or provided by core vents. Background ventilation should normally be positioned 1.7m above floor level to avoid discomfort from cold draughts.

Specific Guidance on Background Ventilation

1. If the dwelling has more than one exposed façade, the area of background ventilators on each façade should be similar, to allow cross-ventilation through the dwelling.
2. If an exposed façade is close to an area of sustained and loud noise (e.g. a main road), then a **noise attenuating background ventilator** should be fitted.
3. The minimum total area of background ventilators in each room should follow the guidance in ADF 1 Table 1.7, copied overleaf.
4. The total number of ventilators installed in the dwelling's habitable rooms and kitchens should be at least the following:
 - a. Four ventilators if the dwelling has one bedroom;
 - b. Five ventilators if the dwelling has more than one bedroom.
5. If the dwelling has a kitchen and living room which are not separate rooms, at least three ventilators of the same area as for other habitable rooms in Table 1.7 should be provided in the open-plan space.

The size of background ventilators (including trickle ventilators) is given in ADF1 as an **equivalent area in mm²**, not as a free area or air permeability. The minimum **equivalent area** on the background ventilator shall have been tested and recorded in accordance with BS EN 13141-1. This will also normally be stamped on the ventilator product. If the equivalent area for the ventilator is not available, the **ventilator may not be fully compliant with ADF1** and therefore should not be used.

The revised version of Document F, 2021, is effective as of 15th June 2022, and includes increased minimum equivalent areas for background ventilators. Please refer to Table 1.7 overleaf for full details.

¹ Please see the notes regarding background ventilation used with extract ventilation Page 9.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 7
-------------	------------	-------------------------	---------------------------	--------

Table 1.7 Minimum equivalent area of background ventilators for natural ventilation⁽¹⁾

Room	Minimum equivalent area of background ventilators for dwellings with multiple floors	Minimum equivalent area of background ventilators for single-storey dwellings
Habitable rooms ⁽²⁾⁽³⁾	8000mm ²	10,000mm ²
Kitchen ⁽²⁾⁽³⁾	8000mm ²	10,000mm ²
Utility room	No minimum	No minimum
Bathroom ⁽⁴⁾	4000mm ²	4000mm ²
Sanitary accommodation	No minimum	No minimum

NOTES:

- The use of this table is not appropriate in any of the following situations and expert advice should be sought.
 - If the dwelling has only one exposed façade.
 - If the dwelling has at least 70% of its openings on the same façade.
 - If a kitchen has no windows or external façade through which a ventilator can be installed.
- Where a kitchen and living room accommodation are not separate rooms (i.e. open plan), no fewer than three ventilators of the same equivalent area as for other habitable rooms should be provided within the open-plan space.
- The total number of ventilators installed in a dwelling's habitable rooms and kitchens should be no fewer than five, except in one-bedroom properties, where there should be no fewer than four.
- If a bathroom has no window or external façade through which a ventilator can be installed, the minimum equivalent area specified should be added to the ventilator sizes specified in other rooms.

What is the Total Number of Background Ventilators Required in a Dwelling?

Previously this was determined by a calculation based upon the gross floor area of the dwelling and the number of bedrooms. Revised Document F, 2021 covers this in points 2, 3 and 4 in the notes in table 1.7 above.

It should be noted that for points 2. and 3. listed under table 1.7 above - The number of ventilators refers to individual ventilators sized at the individual values listed below.

Worked Example to Illustrate the Total Number of Ventilators Required Ref Point 3 in table 1.7.

"The total number of ventilators installed in a dwelling's habitable rooms and kitchens should be no fewer than five": for a dwelling with multiple floors, this would require 5 ventilators in total, correctly sized at 8,000mm² for habitable rooms and 4,000mm² for the kitchen.

Where it is not possible to obtain or install a window trickle vent with an equivalent area of 8,000mm², the installer will be required to install a greater number of ventilators with an equivalent area e.g. 2 x 4,000mm² instead of an 8,000mm² unit.

Clear evidence will have to be uploaded demonstrating the correct number of ventilators have been installed (or are pre-existing) for each habitable and wet rooms where applicable to comply with Table 1.7. Copies of the product data sheet of the ventilator should also be uploaded demonstrating that the equivalent area of the ventilator has been tested in accordance with BS EN 13141-1.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 8
-------------	------------	-------------------------	---------------------------	--------

Background Ventilation Requirements for use in Conjunction with Continuous Extract Ventilation

Where continuous mechanical extract ventilation is used, background ventilators should satisfy all of the following conditions:

- Should not be in wet rooms in **conjunction with continuous extract ventilation (DMEV)** as at the lower fan flow rate, this will only serve to continuously bypass the air in the room. Background ventilation should **only be installed in wet rooms where intermittent extract ventilation (IEV) or Positive Input Ventilation (PIV)** is already existing or is being installed. In the case where an IEV is being used, vents should be located at least 500mm from the extract fan.
- Provide a minimum equivalent area of **4,000mm²** for each habitable room in the dwelling.
- Provide a minimum total number of ventilators that is the same as the number of bedrooms plus two ventilators (i.e. a one-bedroom dwelling should have three background ventilators, a two-bedroom dwelling should have four background ventilators, etc.).

Insulation and Assurance Authority (IAA)

Background Ventilation Assessment of Existing Buildings



The IAA has produced a best practice guide for the assessment of background ventilation to be used pre and post installation of retrofit works in a dwelling.

The assessment process uses the Pulse Air Permeability Testing Equipment to assess the air permeability of a dwelling to ascertain whether the dwelling has sufficient air permeability pre and post install so as not to warrant the requirement for additional background ventilation or upgrades to door undercuts.

A compliant assessment can only be conducted by IAA trained operatives that are certified and listed on the IAA's website for Approved Background Ventilation Assessors.

The process assesses the air permeability of the whole house and every bedroom. Acceptable test results that would indicate that background ventilation upgrades are not required for the dwelling are:

- Whole house test result > **1.0 Ach @ 4Pa** (*air changes per hour at 4 Pascals*)
- Each bedroom tested > **1.5 Ach @ 4Pa**

It should be noted that this assessment process only considers background ventilation and does not have any bearing on the requirements for extract or purge ventilation, which should still be correctly assessed and upgraded if required.

A copy of this guidance can be obtained by contacting the Insulation and Assurance Authority (IAA)

For further information regarding Background Ventilation Assessment of Existing Buildings Training please click on the link: [Ventilation & Air Tightness Testing Training | The IAA CS](#)

Combustion Ventilation Considerations

Existing combustion ventilation **cannot be considered as background ventilation**. Background ventilation, by definition, must be controllable, whereas combustion ventilation must remain permanently open.

Note: Purge ventilation, windows with 'night vent' facility or door undercuts **cannot be considered as an alternative** to background ventilation. This will result in a non-compliant installation.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 9
-------------	------------	-------------------------	---------------------------	--------

4.3. Purge Ventilation

Purge ventilation is required in each **habitable room** and should be capable of extracting at least four air changes per hour per room directly to the outside. It is manually controlled ventilation of rooms at a relatively high rate to rapidly dilute pollutants and/or water vapour e.g. smoke from burnt food or spillage of water. Purge ventilation can typically be provided by an opening window and is classed as intermittent i.e. only to accommodate occasional activities.

The minimum opening areas that should be achieved for purge ventilation are listed in ADF1 Table 1.4 below.

Table 1.4 Purge ventilation openings

Opening type	Minimum total area of openings
Hinged or pivot windows with an opening angle of 15 to 30 degrees	1/10 of the floor area of the room
Hinged or pivot windows with an opening angle of greater than or equal to 30 degrees	1/20 of the floor area of the room
Opening sash windows	
External doors	

Hinged or pivot windows with an opening angle of less than 15 degrees are not suitable for purge ventilation.

Is there a solution to where habitable room does not have purge ventilation?

Where an opening window is not available to provide purge ventilation, a mechanical fan capable of extracting at 4 ACH (Air Changes per hour) on a boost setting to outside could be used. 4 ACH can be found by calculating the volume of the room and converting this from **4 x room volume/hr** to **l/s** to give the flow rate of a suitable fan.

Worked Example for Extract Fan Flow Rate to Achieve 4 ACH (Air Changes per Hour)

Room Dimensions = 3.0m x 3.0m x 2.5m high = **22.5m³**

4 ACH = 4 x 22.5m³ = **90.0m³/hr**

(1m³ = 1,000 Litres, 1 hour = 3,600 seconds)

Convert 4 ACH to l/s = $90.0\text{m}^3/\text{hr} \times \frac{1,000}{3,600} =$ **25l/s Flow Rate Required**

Alternatively, the requirement to provide adequate purge ventilation, the room can room can be ventilated through either of the following:


- Another habitable room;
- A conservatory.

The habitable room or conservatory should have openings to the outside to provide both of the following.

- Purge ventilation with a minimum total area given in Table 1.4 should be achieved based on the combined floor area of the habitable rooms (or the habitable room and the conservatory).
- Background ventilation of at least 10,000mm² equivalent area.

Between the two rooms there should be a permanent opening with a minimum area of 1/20 of the combined floor area of the two rooms (see Diagram 1.3 overleaf).

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 10
-------------	------------	-------------------------	---------------------------	---------

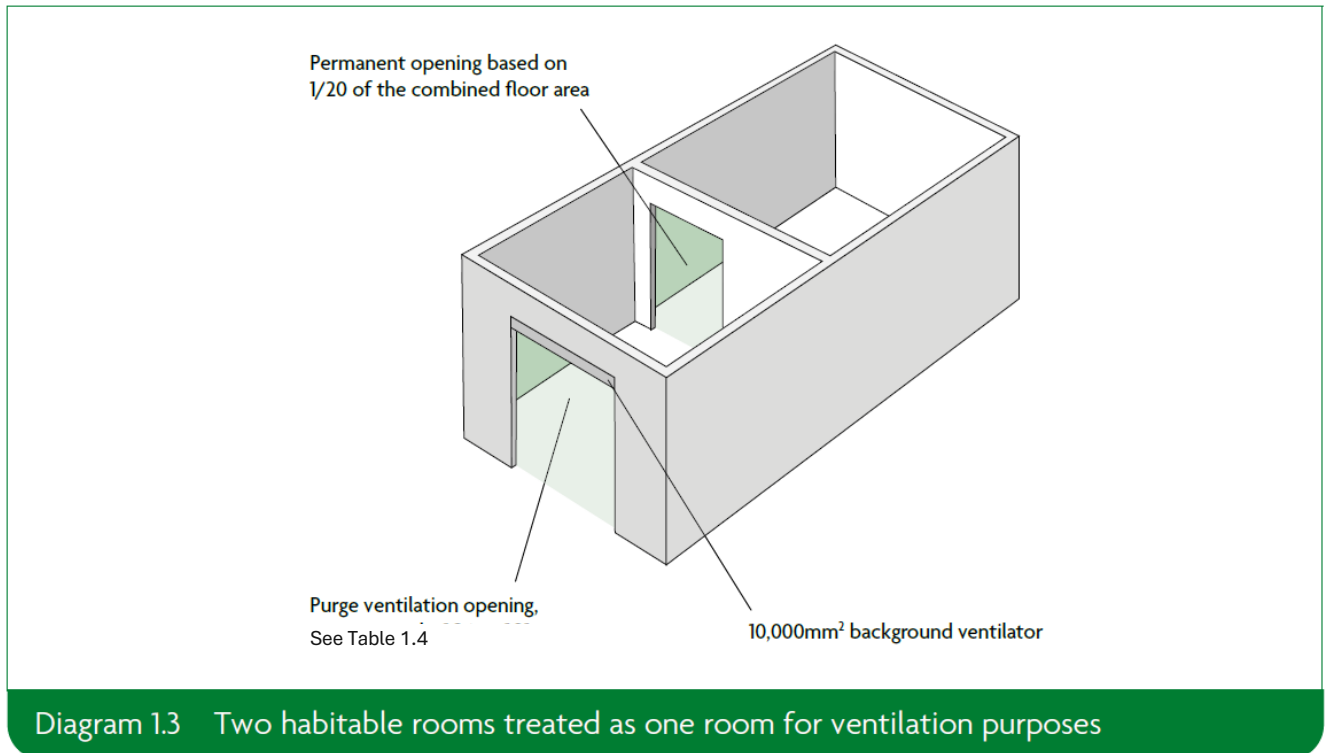

5. Installation of ventilation systems

The following provides overall guidance on the installation of ventilation systems, with a particular focus on extract ventilation ducting:

1. Ventilation should always be installed to meet both of the following conditions:
 - a. Comply with the guidance in **ADF1**.
 - b. Not compromise the performance of the system or systems being installed.
2. Adequate space should be available for access to maintain ventilation equipment.
3. Rigid ducts should be used wherever possible.
4. Flexible ductwork, where installed, should meet all of the following conditions.
 - a. Only used for final connections.
 - b. Lengths should be a maximum of 1.5m.
5. Any flexible ducts should be installed so that the full internal diameter is maintained, and flow resistance is minimised. This is achieved by taking both of the following actions:
 - a. Pulling the duct taut.
 - b. Ensuring that ductwork does not pass through orifices with a smaller diameter than the duct itself.
6. Ductwork installations should be designed and installed to minimise the overall pressure losses within the system by taking all of the following steps.
 - a. Minimising the overall length of duct.
 - b. Minimising the number of bends required.
 - c. Installing appropriately sized ducts for the air flow rate.
7. Where ducting passes through an unheated space e.g. a cold loft, this should be insulated.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 11
-------------	------------	-------------------------	---------------------------	---------

6. Whole Building Ventilation Summary

Combining the three mechanisms and door undercuts provides **whole building ventilation** by means of **extract ventilation** removing moist or stale air from wet rooms, this is in turn replaced by fresh air entering the dwelling through **background ventilators** via the **undercuts in all internal doors**. Occasional pollutants or moisture being removed from the dwelling by means of **purge ventilation**. (See figure 1.)

7. How do we Assess the Existing Ventilation System in a Dwelling?

CoreLogic's PAS Hub Software and App are designed to make it as simple as possible for your Retrofit Assessors and Coordinators, to help you comply with PAS2035.

By working through our Assessor App, the software will help you assess the existing ventilation system and provide guidance on any upgrades to the ventilation system and the individual ventilation mechanisms.

8. PAS 2035 Annex C 3.5 Ventilation Upgrade Suitable Types

PAS2035 specifies that where ventilation is to be upgraded, the minimum acceptable type of ventilation shall be one of the following:

8. **Continuous MEV** consisting of one or more fans tested in accordance with BS EN 13141-6 and extracting moist "stale" air from all "wet" spaces, combined with background ventilators tested in accordance with BS EN 13141-1 in all living spaces and bedrooms to admit a balancing supply of "fresh" external air;
9. **Continuous whole-dwelling MVHR** tested in accordance with BS EN13141-7, extracting moist "stale" air from "wet" spaces and providing a balanced supply of "fresh" external air to all living spaces and bedrooms; or
10. **Continuous PIV** tested in accordance with BS EN 13141-11, providing a supply of "fresh" external air to the centre of the dwelling, combined with background ventilators tested in accordance with BS EN 13141-1 in all living spaces and bedrooms to allow moist "stale" air to escape.

9. Air-tightness – other measures to consider

In addition to insulation measures, other measures impacting upon airtightness that must also be taken into consideration include (but not limited to):

- draught proofing existing windows and doors;
- secondary glazing;
- replacement of existing windows and doors
- sealing up of existing chimneys and flues; and
- the replacement of any open-flued heating or hot water appliance with a room-sealed appliance (i.e. one with a balanced flue).

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 12
-------------	------------	-------------------------	---------------------------	---------

10. Door undercuts

To ensure good transfer of air through the dwelling, there should be an undercut of minimum area of 7,600mm² in **all internal doors** between the bottom of the door and the floor finish. This is equivalent of 10mm for a standard 760mm width door (roughly the thickness of a pen or pencil). This should be achieved by making an undercut of 10mm above the floor finish, or by 20mm undercut above the floorboards, or other surface, if the finish has not been fitted.

There are products on the market that can be installed at the bottom of the doors instead of undercuts, including grills and moulded vents, these are acceptable as long as they provide an **effective ventilation area of 7,600mm²** per internal door.

10.1. Door Undercuts PAS2035 Compliant Evidence Guidelines

To ensure full compliance, please adhere to the following when providing evidence: -

1. Please provide evidence of **all internal doors** (labelling the room in the photographs);
2. Photograph the undercut **with the door closed** (*as per figure 2*) as this is when the undercut is important;
3. Ensure the photographs clearly illustrate the depth of undercut by either placing a pen or pencil in the gap or hold a tape measure against the gap (*ref per figure 2*) - (taking the photo at a low angle and ensuring that it is in focus).

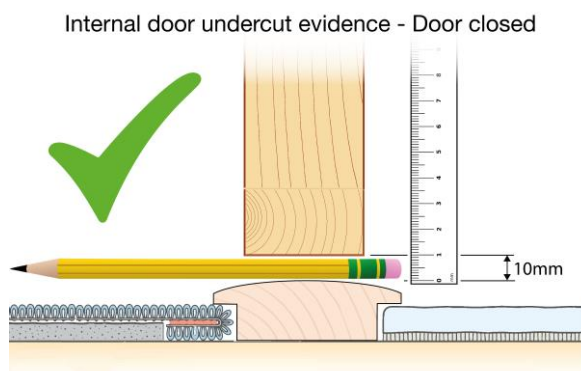


Figure 2 - Correct Evidence with Door Closed

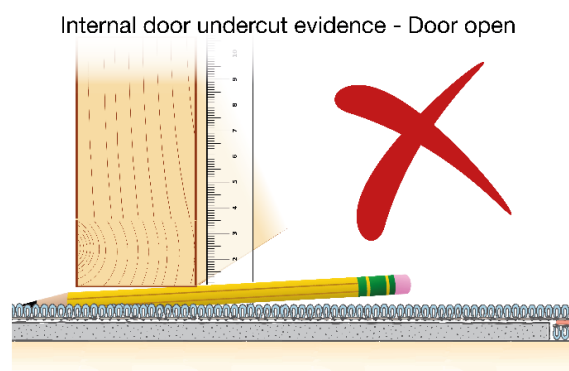


Figure 3 - Incorrect Evidence with Door Open

11. Positive Input Ventilation (PIV)

Note this system is currently acceptable under PAS2035:2019 without the need for extract ventilation in wet rooms. Note that **background ventilation would still be required in wet rooms** to allow for moist / stale air to escape. Also, we would still recommend extract ventilation is installed in wet rooms if not already present. As noted in "PAS2035: PIV systems can drive warm moist air through gaps and holes into cold parts of the construction, and into construction voids (e.g. beneath floors), with a consequent risk of condensation and mould growth."

Where PIV being considered as part of a ventilation system, installers are still required to install appropriate background ventilation and door undercuts. **PIV must not be installed with Internal Wall Insulation (IWI)**, as this will increase the risk of interstitial condensation due to warm wet air being actively pushed into the building fabric by the PIV system.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 13
-------------	------------	-------------------------	---------------------------	---------

12. Ventilation Training and Accreditation

Ventilation systems are to be commissioned and tested by competent operatives holding suitable qualifications. This accreditation is currently available via the competent persons course provided by the NICEIC (National Inspection Council for Electrical Installation Contracting).

<https://www.niceic.com/contractor/training/health-and-safety-courses/domestic-ventilation>

13. Building Regulations Approval – Mechanical Extract Ventilation

All mechanical extract ventilation systems are to be notified to building regulations through a Competent Person Scheme (CPS). Currently Intermittent Extract Ventilation (IEV) is the exception to this requirement. Also, PIV systems currently cannot be notified by a Competent Person Scheme and therefore must be notified directly to a Building Control Officer.

14. What Evidence is Required for Compliant Trustmark Lodgment?

To help make the pre and post approval processes as fast and efficient as possible for Retrofit Coordinators, Installers are required to **provide clear photographic evidence** demonstrating compliance with PAS2035.

Clear photographic evidence of all existing and ventilation upgrades is required to evidence:

- **Extract Ventilation** - Photographs of each individual extract fan in each wet room and ideally photographs of the corresponding external vents;
- **Background Ventilation** – a record of all existing background vents and additional vents required to upgrade the ventilation – clearly evidencing that the revised higher areas required for background ventilation have been provided (Ref ADF1 Table 1.7);
- **Purge Ventilation** – records of all purge ventilation (i.e. photographs of opening windows)
- **Door Undercuts** - Photographs of **each internal door** illustrating the undercut either by means of a pencil inserted into the gap, or a tape measure being held up against the undercut – please ensure that these are taken **with the door closed**; (*ref per figure 2*)
- **Condensation / Mould** – assessment of any existing issues.

Additional Evidence Required for Ventilation

- **IAA Background Ventilation Assessment (Pulse test)** – where the IAA guidance has been used to assess the requirements of background ventilation and door undercuts:
 - Copies of all relevant Pulse Test Certificates (Pre and post install);
 - Tester competency certification;
 - Tester registration on IAA Website - Approved Background Ventilation Assessors; [IAA Approved Background Ventilation Assessors \(theiaa.co.uk\)](http://theiaa.co.uk)
 - Ventilation strategy for use with Pulse Test - recording that background ventilation and door undercuts have been assessed in accordance with the IAA Guidance and upgrades to background ventilation and door undercuts are not required.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 14
-------------	------------	-------------------------	---------------------------	---------

- **Ventilation Strategy** – detailed assessment of the existing ventilation system and where this does not comply with PAS2035 / Building Regulations ADF1, comments on where and how this will be upgraded. This should consider:
 - Extract ventilation in wet rooms;
 - Background ventilation in habitable rooms (and wet rooms where applicable²);
 - Adequate door undercuts on all internal doors²;
 - Purge ventilation;
 - Any evidence of mould and/or condensation at the dwelling.
- **Product Data Sheets** – data sheets for all ventilation upgrade products – (particularly for background ventilation detailing the equivalent area of the ventilator as tested to BS EN 13141-1)

15. Ventilation Strategy Template

ecmk has created a simple Ventilation Strategy Template to help installers assess existing ventilation and plan for any upgrades required.

² Where background ventilation has been tested in accordance with the IAA Guidance, the ventilation strategy should comment that: “background ventilation and door undercut upgrades are not required as the air permeability of the property has been tested in accordance with IAA guidance and found to be >1.0 ACH”

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 15
-------------	------------	-------------------------	---------------------------	---------

16. Glossary

- **ADF1** - Building Regulations 2010 Ventilation, Approved Document F, Volume 1: Dwellings, 2021 Edition
- **Air permeability** - The measure of airtightness of the building fabric. It is defined as the air leakage rate per hour per m² of envelope area at the test reference pressure differential of 50Pa or 4Pa.
- **Airtightness** - The resistance of the building envelope to infiltration when ventilators are closed. The greater the airtightness at a given pressure difference across the envelope, the lower the infiltration.
- **Background ventilator** - A small ventilation opening designed to provide controllable whole dwelling ventilation.
- **Building control body** - A local authority or an approved inspector.
- **Continuous mechanical extract ventilation** - Mechanically driven ventilation that continuously extracts indoor air and discharges it to the outside.
- **Dwelling** - A self-contained unit designed to accommodate a single household.
- **Equivalent area** - A measure of the aerodynamic performance of a ventilator. The equivalent area of a background ventilator is determined at 1Pa pressure difference in accordance with Table 1.7.
- **Extract ventilation** - The removal of air directly from an internal space or spaces to the outside. Extract ventilation may be by natural means or by mechanical means (e.g. by an extract fan or a central system).
- **Free area** - The geometric open area of a ventilator
- **Habitable Rooms** – a room used for living purposes e.g., living room, dining room, office / study, bedrooms.
- **Heat recovery** - Applied to mechanical supply and extract systems or a single room ventilator, extract air is passed over a heat exchanger and the recovered heat is put into the supply air.
- **Highly airtight dwellings** - Dwellings that achieve one of the following:
 - a. A design air permeability lower than 5m³/(h·m²) at 50Pa;
 - b. An as-built air permeability lower than 3m³/(h·m²) at 50Pa.
- **Infiltration** - The uncontrolled exchange of air between the inside and outside of a building, through gaps and cracks.
- **Intermittent operation** - When a mechanical ventilator does not run all the time, usually running only when there is a particular need to remove pollutants or water vapour (e.g. during cooking or bathing). An intermittent operation may be under either manual or automatic control.
- **Permanent opening** - An opening between rooms or floors that has no means of closing it, e.g. an open stairwell or two rooms that have been joined by removing part of a wall.
- **Purge ventilation** - Manually controlled ventilation of rooms or spaces at a relatively high rate to rapidly dilute pollutants and/or disperse water vapour. Purge ventilation may be provided by natural means (e.g. an openable window) or mechanical means (e.g. a fan).
- **Sanitary accommodation** - A space containing one or more flush toilets (WCs) or urinals. Sanitary accommodation containing one or more cubicles counts as one space if there is free circulation of air throughout the space.
- **Utility room** - A room containing a sink or other feature or equipment that may reasonably be expected to produce significant quantities of water vapour.
- **Wet Rooms** – a room used for domestic activities (e.g., cooking, clothes washing and bathing) and include kitchens, bathrooms, shower rooms, utility rooms, and sanitary accommodation/WCs.
- **Whole dwelling ventilation** - (general ventilation) Nominally continuous ventilation of rooms or spaces at a relatively low rate to dilute and remove pollutants and water vapour not removed by extract ventilation, purge ventilation or infiltration, as well as to supply outdoor air into the dwelling.

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 16
-------------	------------	-------------------------	---------------------------	---------

17. References

- Building Regulations 2010 Ventilation, Approved Document F, Volume 1: Dwellings, 2021 Edition
- Building Regulations 2010 Combustion Appliances and Fuel Storage Systems Document J, 2013 Amendments
- Building Regulations 2010 Combustion Conservation of Fuel and Power in Existing Dwellings, Approved Document L1B, 2018 Amendments
- Building Regulations 2010 Overheating Requirement O1: Overheating mitigation Regulations: 40B, 2021
- PAS2030+A1 2020 and PAS2035+A1 2022 Updates 31 January 2022 - Annex C (Normative) Requirements for provision of adequate ventilation
- The IAA Ventilation Assessment of Existing Buildings - Best Practice Guide – v1.1
- BS EN 13141-1:2019 Ventilation for buildings - performance testing of components/products for residential ventilation. Part 1. Externally and internally mounted air transfer devices
- BSRIA Guide Domestic Ventilation Systems - a guide to measuring airflow rates (BG 46/2015)
- BEIS Guide to Best Practice Retrofit Internal Wall Insulation, September 2021
- Domestic Ventilation Compliance Guide 2010 Edition, Department for Communities and Local Government, July 2011

Revision 01	14.06.2022	Created by: Nigel Jones	Approved by: Chris Wilkes	Page 17
-------------	------------	-------------------------	---------------------------	---------